Data Point Shape
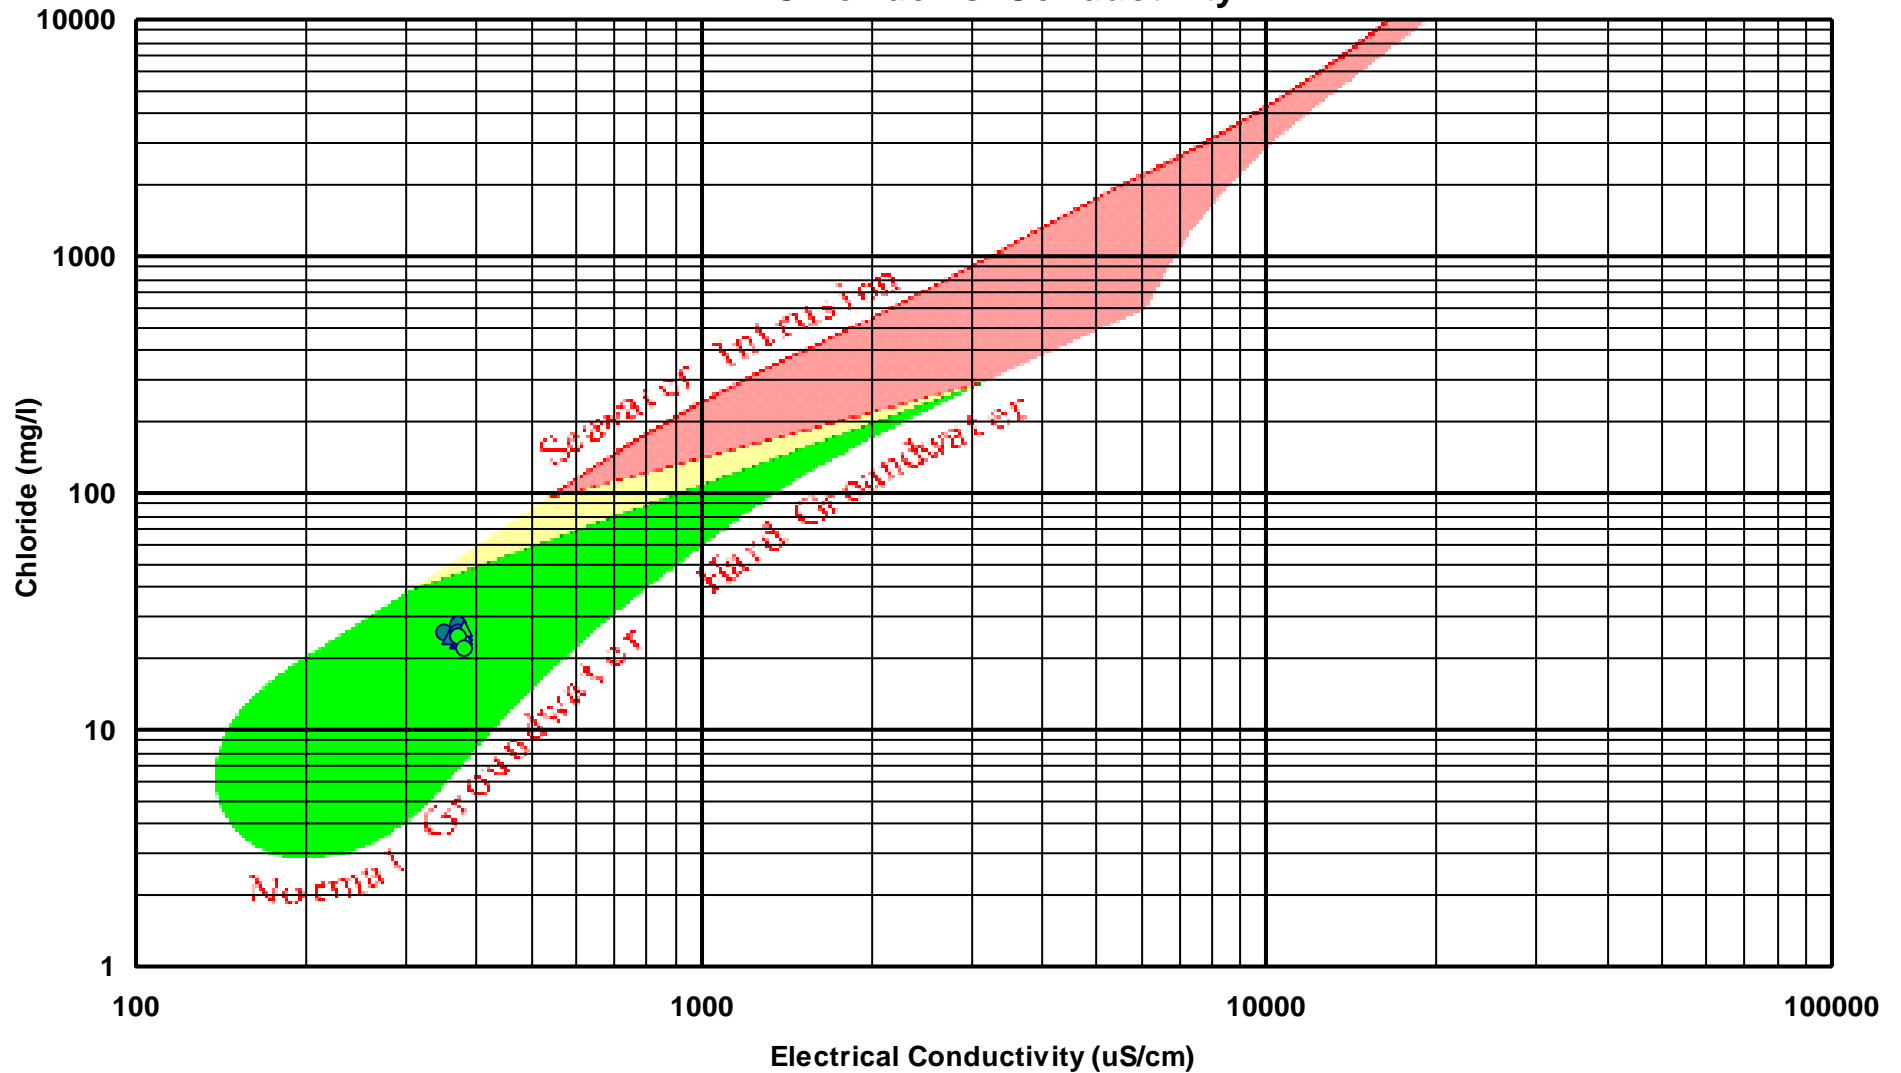**Indicates Sample Season**

△ June - September
◯ October - May

Chloride vs Electrical Conductivity
Well: BWT

Data Point Fill Color
Indicates Sample Date

09/10/02   04/23/14

Chloride vs. Conductivity

Chloride (mg/l) — vertical axis: 1, 10, 100, 1000, 10000

Electrical Conductivity (uS/cm) — horizontal axis: 100, 1000, 10000, 100000

Seawater Intrusion

Hard Groundwater

Normal Groundwater

Disclaimer: Data presented has been collected from a variety of sources. Island County makes no guarantee as to the validity or accuracy of this data.
Please report any errors to the Island County Hydrogeologist